


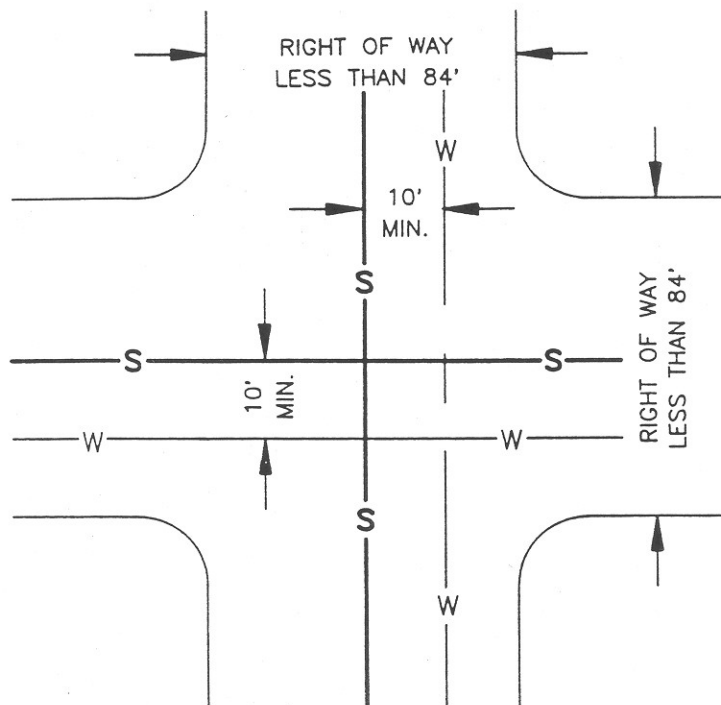


WATER & SEWER MAINS

NO SCALE

NOTES

1. WATER LINE SHALL BE 10' SOUTH OR 10' EAST OF THE CENTERLINE OF THE STREET.
2. A 10' MINIMUM SEPARATION SHALL BE MAINTAINED FROM THE SEWER LINE.
3. THE CITY PREFERS THAT SEWER LINES ARE SITUATED ALONG THE STREET C. ANY DEVIATION MUST BE APPROVED BY THE CITY ENGINEER.
4. WHERE NECESSARY, CURVED SEWERS SHALL BE ALLOWED.

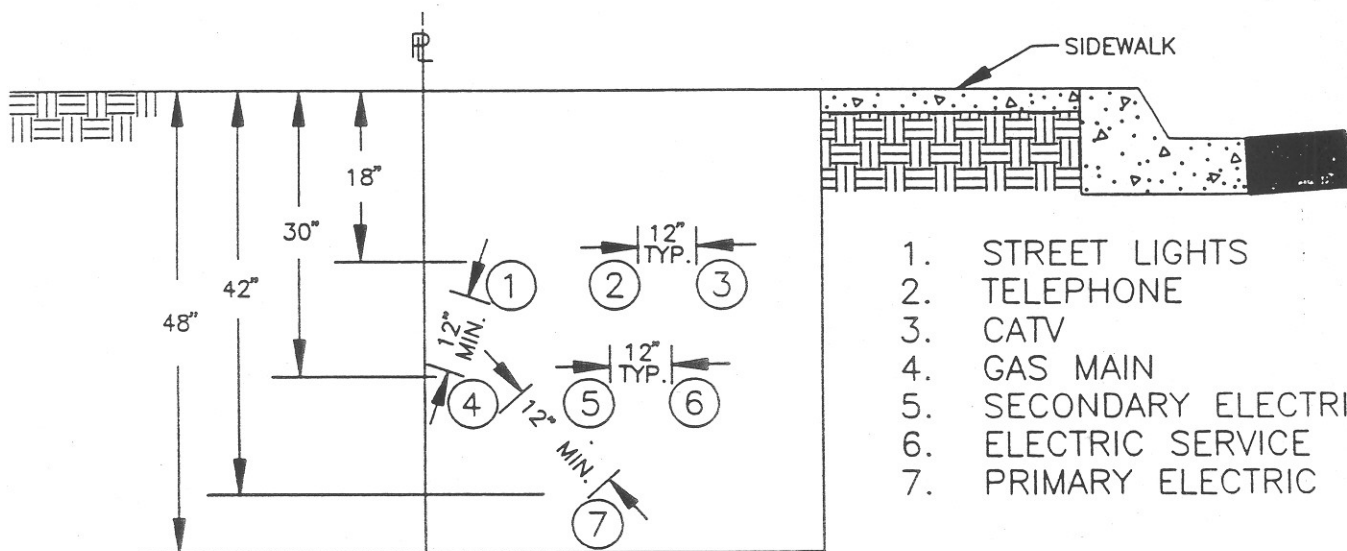

UTILITY TRENCH DETAIL

NO SCALE

1. STREET LIGHTS
2. TELEPHONE
3. CATV
4. GAS MAIN
5. SECONDARY ELECTRIC
6. ELECTRIC SERVICE
7. PRIMARY ELECTRIC

Revision	By	Approved	Date

CITY OF OCEANSIDE

**PLACEMENT OF
UNDERGROUND UTILITIES**

Ronald A. Beech 4/9/94
CITY ENGINEER Date
STANDARD
DRAWING NO. M-14